

TEST REPORT

TEST LOCATION

CÁMARAS DE ENSAYO NORMALIZADAS DE AUDIOTEC. C/JUANELO TURRIANO, 4. PARQUE TECNOLÓGICO DE BOECILLO. BOECILLO. (VALLADOLID) ESPAÑA

TEST

Laboratory measurement of the improvement of airborne sound insulation of a horizontal enclosure

SAMPLE

Supporting enclosure: Concrete reference slab, 14 cm thick.

Covering: "Akustik + Sylomer® 25 Floor Mount", made by AMC, with 50 x 50 mm wooden battens with 45 mm mineral wool between them + Rigidur Flooring Element 20 mm + Rigidur H BR 13 mm plasterboard

TEST METHOD

**UNE EN ISO 10140-1:2016. Annex G
UNE EN ISO 10140-2:2011**

CUSTOMER

AMC Mekanocaucho
Industrialdea Zona A. Pab 35.
Asteasu E-20159, Gipuzkoa

TEST DATE:

October 14th and 19th, 2020

Technician

Reviewed

Signed: Marcos Merillas Fernández
Laboratory Technician

Signed: Ángel Arenaz Gombau
Laboratory Technical Director

CONTENT

1.- Test object

2.- Test procedure

2.1.- Procedures and standards used

2.2.- Methodology and test parameters

2.3.- Instrumentation used

2.4.- Product identification

2.5.- Sample installation process

2.6.- Test characteristics and conditions

2.7.- Pictures of assembly

3.- Test results

1.- TEST OBJECT

Evaluation in standardized test rooms of the improvement of the sound reduction index, ΔR , of a complementary covering:

Construction system identification: Sistema horizontal compuesto por:

- **Supporting enclosure:** Concrete reference slab, 14 cm thick.
- **Covering:** “Akustik + Sylomer® 25 Floor Mount”, made by AMC, with 50 x 50 mm wooden battens with 45 mm mineral wool between them + Rigidur Flooring Element 20 mm + Rigidur H BR 13 mm plasterboard

The test has been carried out in AUDIOTEC’s standardized test rooms in Boecillo Technology Park (Valladolid).

2.- TEST PROCEDURE

2.1- Procedures and standards used

The test has been carried out taking into account the following laboratory standards and procedures:

- *UNE-EN ISO 10140-2:2011. Acoustics – Laboratory measurement of sound insulation of building elements – Part 2: Measurement of airborne sound insulation.*
- *Annex G of UNE-EN ISO 10140-1:2016 (Acoustical linings – Improvement of airborne sound insulation).*
- *Annex B of UNE-EN ISO 10140-5:2011 (Standard basic elements for measuring the improvement of airborne sound insulation by linings).*
- *Annex E of Basic Document DB HR Noise Protection. April 2009.*
- *Measurement procedure and calculations presented in specific procedures PE-36 and PE-38 of AUDIOTEC's Acoustics Laboratory.*

2.2.- Methodology and test parameters

The rooms where the test was carried out comply with the regulations and requirements established in the UNE EN ISO 10140-5:2011 Standard. They are vertically adjacent rooms. One of them, the lower one or receiving, is fixed and sits under the floor level. The other one, the upper one or source room, is mobile and is placed over the slab to be tested. Both have the shape of irregular 6-faced prisms without parallel corners. The walls of the receiving room are 30 cm concrete walls and inner acoustic claddings covered with 15 mm plasterboard. It's volume is 52,8 m³. Upper chamber's walls are made of a 15 cm sandwich metal structure on the outside, reinforced with acoustic insulating and absorbing materials and an inside acoustic cladding.

To test were performed, the first one with the whole system (supporting slab + covering) and, afterwards, the reference slab was tested alone. The methodology for each one of them is the same and is described below:

Pink noise was generated in 2 loudspeaker positions in the source room (mobile), located at least 0.7 m from the existing walls and on a tripod at different heights. For each loudspeaker position, three measurements were made with a rotating microphone in the diffuse field area of the source room. The microphone stayed at a minimum distance of 0.7 m from the side walls, 1 m from the loudspeaker, and 1 m from the sample under test. The scanning radius of the microphone was of 1 m with a minimum inclination of 10°.

For each loudspeaker position, three measurements were made with a rotating microphone in the diffuse field area of the receiving room. The microphone stayed at a minimum distance of 0.7 m from the side walls and 1 m from the sample under test. The scanning radius of the microphone was of 1 m with a minimum inclination of 10°.

Afterwards, the background noise in the receiving room was measured with no loudspeaker.

The time of each measurement was 48 seconds (3 full sweeps), enough time for the signal to stabilize.

The measurements were made in each of the 1/3 octave bands between 100 and 5000 Hz.

In order to measure the reverberation time, 2 loudspeaker positions were used in the receiving room with a separation of more than 3 m between them.

For each loudspeaker position, 3 microphone positions were used in the receiving room to measure the reverberation. All of them were at a distance of more than 1 m from the side walls, 1.8 m between them and 2 m from the loudspeaker. Two measurements were taken in each position and the respective averages were obtained. The TR20 was measured.

2.3.- Instrumentation used

The instrumentation used in this test was the following:


- Brüel & Kjaer Sound source type 4292, serial number 004007.
- PULSE Analyzer, model B&K 3560-B-030, serial number 2538701.
- PHONIC MAX 860 Amplifier, serial number ABA2GBA171.
- Third octave band equalizer BEHRINGER model DEQ2496.
- B&K Microphone 4189, serial number 2534182, and B&K preamp 2669, serial number 2532870.
- B&K Microphone 4189, serial number 2345614, and B&K preamp 2669, serial number 2532823.
- B&K Sound calibrator type 4231, class 1, serial number 2136530.
- BARIGO Thermoanemometer, model num. 525.

2.4.- Identification and description of the sample


PRODUCT	DIMENSIONS	BRAND/MODEL	ESSENTIAL PROPERTIES	
Concrete reference slab (supporting closing)	400 x 440 cm	--	Mass per unit area	351 kg/m ²
			Surface	17.6 m ²
Floor mount	--	Akustik + Sylomer® 25 Floor Mount	Maximum load	25 kg
				55 lbs
Sylomer	--	SR11	Thickness	12 mm
Wooden battens	50 x 50 mm	--	--	--
Rigidur Flooring Element 20	150 x 50 mm (length x width)	--	Thickness	20 mm
Rigidur H BR 13 plasterboard	2400 x 1200 mm (length x width)	--	Thickness	13 mm
Rigidur glue	--	--	--	--

PRODUCT	DIMENSIONS	BRAND/MODEL	ESSENTIAL PROPERTIES	
Mineral wool	--	--	Thickness	45 mm
Screws	--	--	--	--
Silicone	--	--	--	--
Fast fix adhesive	--	--	--	--


Sample sketch:

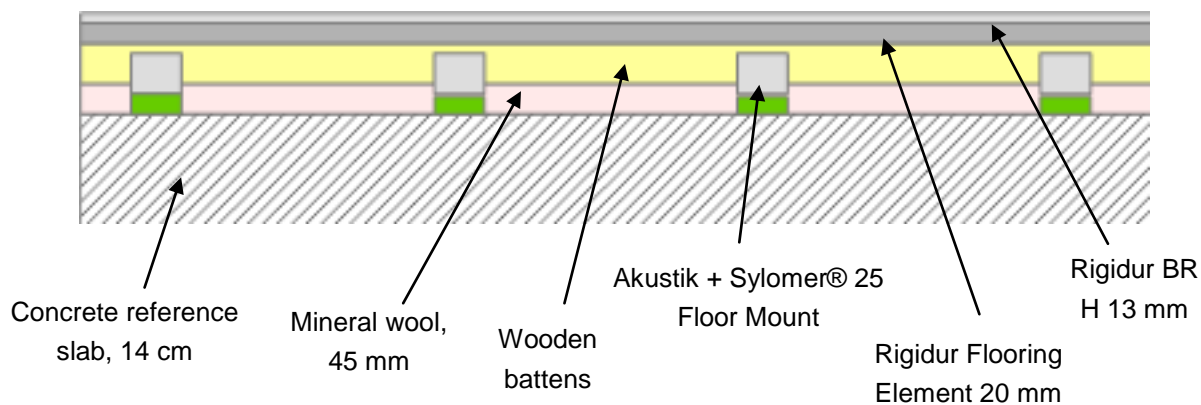

Mount sketch (dimensions in millimeters):

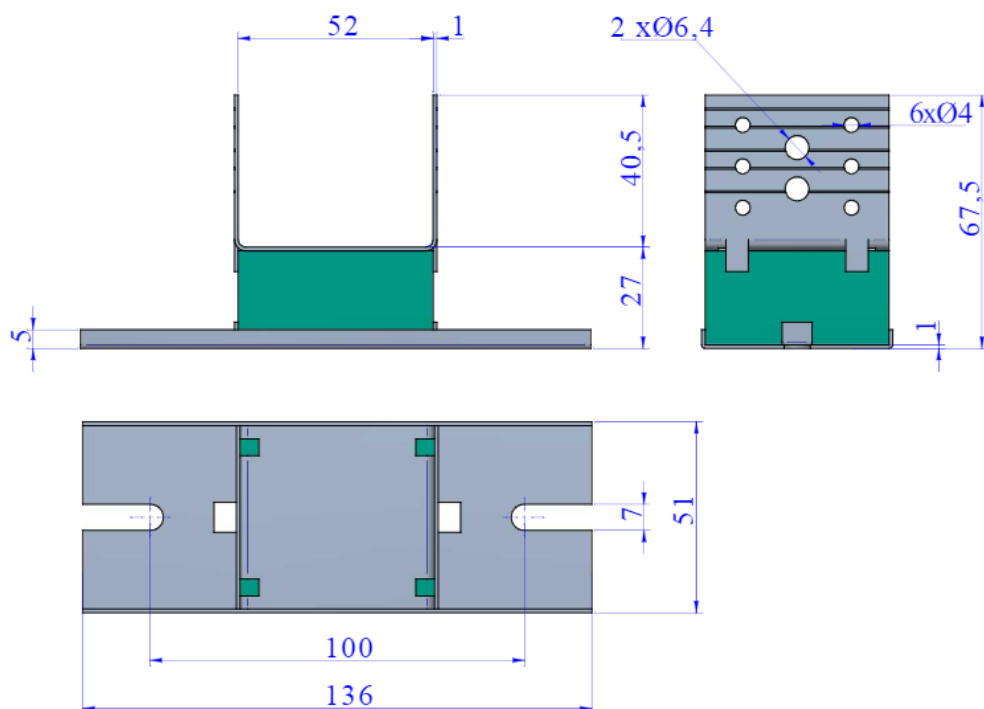

Mount picture:

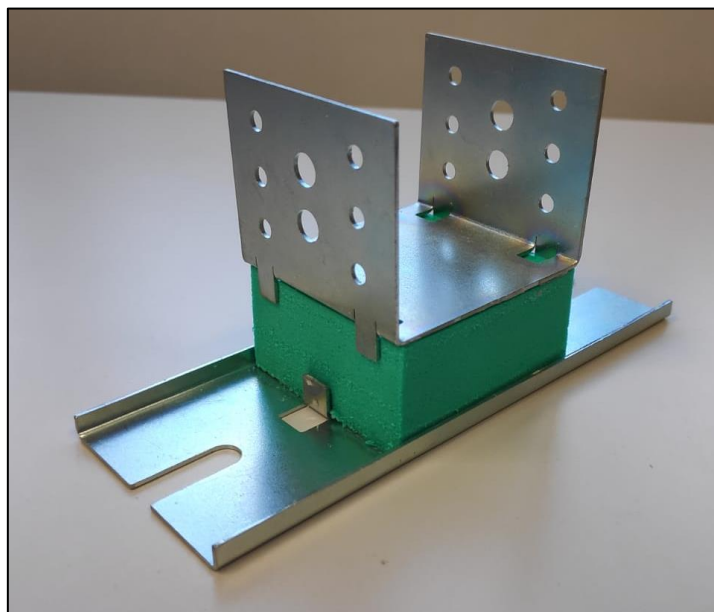

2.5.- Sample installation process

The standardized reference slab was installed between the receiving and the source room.

Over the slab, the mounts “Akustik + Sylomer® 25 Floor Mount” were fixed using fast fix adhesive. 8 mount rows were installed, with a separation of 50 cm between them, and a separation of 50 cm between the mounts of each row. Next, the wooden battens were placed and screwed over each mount row.

After that, Sylomer SR11 was installed in the whole perimeter in order to avoid direct contact between the floating floor and the chamber. In the gaps between the battens, strips of 45 mm thick mineral wool were installed. Rigidur Flooring Element 20 mm boards with rebate edges were installed on the battens. The boards were fixed using special glue and screws. Over this first board floor, another plasterboard was installed, using as well glue and screws to fix them. Last, joints between boards were sealed with joint paste, and the perimeter was sealed with silicone.

2.6.- Test characteristics and conditions

Approximate nominal thickness of the system: 25 cm (slab, 14 cm + mounts, 2.7 cm + battens, 5 cm + flooring element board, 2 cm + second plasterboard, 1.3 cm). Mass per unit area of the system: 396.1 kg/m² (slab, 351 kg/m² + mounts, 0.6 kg/m² + battens, 5.5 kg/m² + flooring element board, 24.1 kg/m² + second plasterboard, 15 kg/m²).

Dimensions of the measurement aperture are 3.3 m wide per 3.675 m long. Common surface between the chambers is 12.12 m².

Approximate sample surface is 14,58 m².

The tested sample was installed by operators outsourced by AUDIOTEC.

Upper room volume is 58,35 m³ and lower room volume is 52,83 m³.

For the test of the supporting slab:

In the source room temperature was 22.15 °C ± 0,1; relative humidity was 48.5 % ± 1,4; and static pressure was 960 hPa ± 0.

In the receiving room temperature was 21.55 °C ± 0,1; relative humidity was 47.5 % ± 0; and static pressure was 960 hPa ± 0.

For the test of the complete system:

In the source room temperature was 21,0 °C ± 0,1; relative humidity was 46,1 % ± 0; and static pressure was 1022 hPa ± 0.

In the receiving room temperature was 21,6 °C ± 0,1; relative humidity was 45,8 % ± 0; and static pressure was 1022 hPa ± 0.

2.7.- Pictures of assembly









3.- TEST RESULTS

Next page shows a brief description of the tested sample and a chart with the values of the sound reduction index for each third octave frequency band, in dB, as well as its corresponding graphic. It also shows the values $R_{with,}$ $R_{without}$ and ΔR following the specifications of chapter G.6. of ISO 10140-1:2010 and the values of $R_w(C,C_{tr})_{without}$ y $R_w(C,C_{tr})_{with}$.

Notes:

- ♦ The results of this test only concern the tested elements and in the moment and conditions in which the measurements were made.
- ♦ Measurement uncertainty is available to the customer in AUDIOTEC Acoustics Laboratory.
- ♦ This report must not be reproduced by any means unless it is made entirely and with the AUDIOTEC S.A. Acoustics Laboratory authorization.
- ♦ The standard UNE EN ISO 10140-2:2011 replaces UNE EN ISO 140-3:1995.
- ♦ Annex G of the standard UNE EN ISO 10140-1:2016 replaces annex G of the standard UNE EN ISO 10140-1:2011, which in turn replaces the standard UNE EN ISO 140-16:2007.


Customer: AMC Mecanocaucho

Identification of the sample:


- (1) Rigidur H BR plasterboard, 13 mm
- (2) Rigidur Flooring Element, 20 mm
- (3) Wooden battens, 5 cm
- (4) Akustik + Sylomer® Floor Mount 25
- (5) Mineral wool 45 mm
- (6) Concrete reference slab 14 cm

Test method: UNE-EN ISO 10140-1, Annex G

Thickness: 25 cm; **Mass per unit area:** 396,1 kg/m²

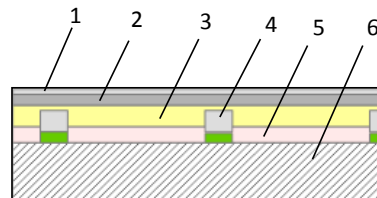

Freq f Hz	R _{with} dB	R _{without} dB	ΔR dB
100	54,0	47,3	6,7
125	59,7	48,7	11,0
160	61,5	47,8	13,7
200	64,9	46,1	18,8
250	62,9	40,4	22,5
315	65,2	44,2	21,0
400	65,6	45,3	20,3
500	70,5	46,2	24,3
630	76,0	49,3	26,7
800	76,2	51,8	24,4
1000	79,5	58,3	21,2
1250	81,3	62,0	19,3
1600	83,5	63,5	20,0
2000	83,1	66,4	16,7
2500	82,4	69,1	13,3
3150	81,9	70,8	11,1
4000	79,0	72,2	6,8
5000	78,3	74,1	4,2

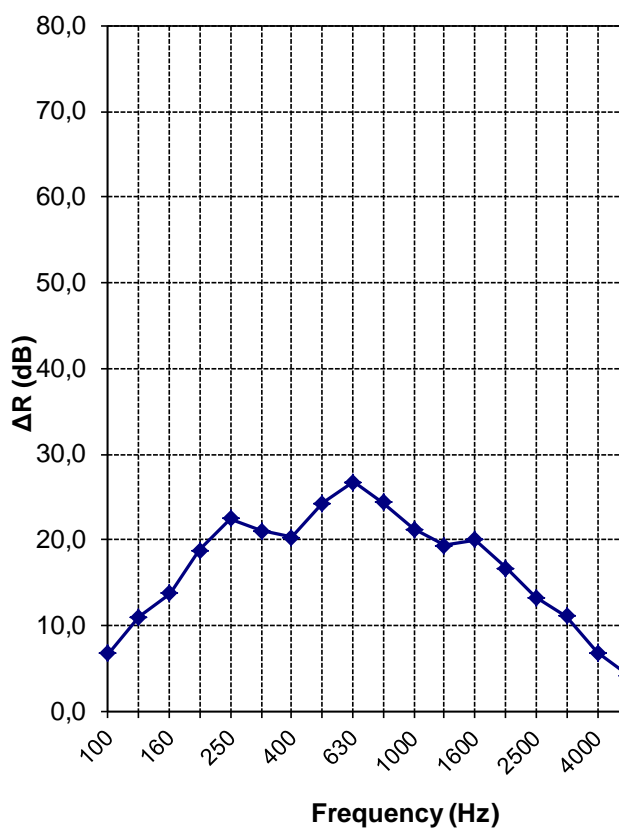

R_{wef} (C;Ctr) without = 52 (0;-5) dB

R_{wref} (C;Ctr) with = 71 (-2;-8) dB

Δ(R_w + C)_{heavy} = 17 dB

Δ(R_w + C)_{heavy} = 16 dB

ΔR(A) (DB-HR) = 18 dBA

Test date: October 14th and 19th, 2020

ΔR_w heavy = 19 dB

Technician:

Reviewed :

Signed: Marcos Merillas

Signed: Ángel Arenaz



902 37 37 99

www.audiotec.es

laboratorio@audiotec.es

